

DIVISION: 05 00 00 METALS

Section: 05 40 00 Cold-Formed Metal Framing

REPORT HOLDER:

Fortress Framing, LLC
1720 N. 1st Street
Garland, TX 75040
972-231-4001

www.FortressFraming.com

REPORT SUBJECT:

Evolution Steel Framing

1.0 SCOPE OF EVALUATION

1.1 This Research Report addresses compliance with the following Codes:

- 2018 *International Building Code*® (IBC)
- 2018 *International Residential Code*® (IRC)

1.2 *Evolution Steel Framing* has been evaluated for the following properties:

- Structural Performance

1.3 *Evolution Steel Framing* has been evaluated for the following uses:

- As described in this report, *Evolution Steel Framing* is a cold-formed steel framing system used as the structural framing of an exterior deck.

2.0 STATEMENT OF COMPLIANCE

Evolution Steel Framing complies with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.

3.0 DESCRIPTION

3.1 *Evolution Steel Framing* is an assemblage of cold-formed steel components manufactured from galvanized carbon structural steel with a powder coat finish, installed with metal brackets, hangers, and fasteners.

3.2 Joists are manufactured from 16-gauge and 18-gauge carbon structural steel galvanized ASTM A653 G60 and ASTM A653 G90, respectively. See Figure 2 for nominal section profiles.

3.3 Ledgers are manufactured from 14-gauge carbon structural steel galvanized ASTM A653 G60, , cold-formed in an “S” shape. See Figure 3 for nominal section profiles.

3.4 Rim joists are manufactured from 14-gauge carbon structural steel galvanized ASTM A653 G60, cold-formed in a “C” shape. See Figure 4 for nominal section profiles.

3.5 Beams are provided in single and double beams. Single beams consist of two 16-gauge structural steel galvanized ASTM A653 G60 cold-formed “J” shaped channels, that are factory welded to form a beam. The webs of the beams have an embossed pattern spaced 6 inches o.c. Double beams consist of two single beams, factory assembled with two double beam tracks fastened to the top and bottom edges with Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws spaced staggered 6 inches o.c. See Figure 6 for nominal section profiles.

3.6 Support posts are manufactured from 11-gauge structural steel galvanized ASTM A653 G60 , in a 3.5-inch square cross-section. See Figure 5 for nominal section profile.



3.7 Brackets and connectors are manufactured from structural steel, galvanized ASTM A653 G60 of various steel thicknesses.

- 14-gauge: Ledger brackets and 45-degree brackets.
- 16-gauge: F-50 brackets, F-10 brackets, single beam post brackets, double beam post brackets, pier spacer and post to pier bracket.
- 18-gauge: Rim joist brackets.
- 20-gauge: Joist straps, joist blocking, double hangers, and single hangers.

4.0 PERFORMANCE CHARACTERISTICS

4.1 Allowable maximum spans for joists are given in Table 2 with respect to joist spacing of 12 or 16 inches o.c. See Figure 1 for assembly and definition of joist spans.

4.2 Allowable maximum spans for single beams and double beams are given in Tables 3 thru 14 with respect to joist spacing of 12 or 16 inches o.c. See Figure 1 for assembly and definition of beam spans.

4.3 Allowable maximum heights for steel support posts are given in Table 15.

4.4 *Evolution Steel Framing* details for supporting guard support posts are not within the scope of this evaluation. Framing must be designed and constructed to resist design loads for guards specified in IBC Section 1607.8 and IRC Table R301.5.

4.5 *Evolution Steel Framing* has not been evaluated for anchorage to the primary structure. See Paragraph 6.2.1.

5.0 INSTALLATION

5.1 General: *Evolution Steel Framing* must be installed in accordance with the manufacturer's published installation instructions, the applicable Code, and this Research Report. A copy of the manufacturer's instructions must be available on the jobsite during installation.

5.2 See Table 1 for *Evolution Steel Framing* fastening schedule. Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws for steel-to-steel connections, installed with an edge distance and center-to-center spacing of no less than 1/2 inches. Screws shall extend through the steel a minimum of three exposed threads.

5.3 Joists bear on the top flange of the beam (dropped beam construction) or fasten into the side of the beam via hanger brackets (flush beam construction). Beams are attached to steel support posts using single and double beam post brackets as illustrated in Figure 11. Wood support posts are outside the scope of this report.

5.4 Joist blocking is required every bay at joist mid-span. Joist straps are used for blocking of 12 inch or 16 inches on center joist spacing. Joist spacing of different lengths utilize sections of 16-gauge or 18-gauge joists, which are installed using F-50 ledger brackets. See Figure 10 for joist blocking details.

5.5 Splicing of joists is outside the scope of this report.

5.6 Deck framing anchorage for lateral load shall comply with IRC Sections R507.1 and R507.2, and IBC Section 1604.8.3. See Paragraph 6.2.1.

5.7 Deck boards shall be directly fastened to each joist.

6.0 CONDITIONS OF USE

6.1 Installation must comply with this Research Report, the manufacturer's published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

6.2 *Evolution Steel Framing*, identified in this report, is deemed to comply with the intent of the provisions of the referenced building codes subject to the following conditions in 6.2.1 through 6.2.6:

6.2.1 Additional design and construction are required for anchorage of lateral loads to the primary framing in accordance with IRC Sections R507.1 and R507.2, and IBC Section 1604.8.3.

6.2.2 Wind uplift capacity of the deck boards and deck board fasteners shall be demonstrated to the building official's satisfaction.





6.2.3 Anchorage of the support posts is outside the scope of this report and shall be performed by a qualified engineer in accordance with the referenced codes. Where required by the building official, engineering calculations shall verify that the anchorage complies with the building code for the type of framing and condition of the supporting construction.

6.3 Stair construction details are not within the scope of this report.

6.4 *Evolution Steel Framing* is manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc.

7.0 SUPPORTING EVIDENCE

7.1 Manufacturer's drawings and installation instructions.

7.2 Reports of engineering analysis in accordance with ICC-ES AC46, Acceptance Criteria for Cold-Formed Steel Framing Members, revised April 2015.

7.3 Reports of testing and engineering analysis in accordance with AISI S100-2016, North American Specification for the Design of Cold-Formed Steel Structural Members.

7.4 Documentation of an Intertek approved quality control system for the manufacturing of products recognized in this report.

8.0 IDENTIFICATION

8.1 *Evolution Steel Framing* components produced in accordance with this report shall be identified with a legible label, stencil, stamp or embossment, at a maximum of 96 inches on center, with the following information:

8.1.1 Manufacturer's identification (Fortress Framing), address, telephone number, website URL;

8.1.2 The product name (*Evolution Steel Framing*);

8.1.3 The material minimum base steel thickness;

8.1.4 Minimum coating designation (G60);

8.1.5 Minimum yield strength;

8.1.6 The Intertek Mark as shown below, and the Code Compliance Research Report number (CCRR-0313).



9.0 OTHER CODES

This section is not applicable.

10.0 CODE COMPLIANCE RESEARCH REPORT USE

10.1 Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

10.2 Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

10.3 Reference to the <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.

This Code Compliance Research Report ("Report") is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.





TABLE 1 – EVOLUTION FRAMING FASTENING SCHEDULE

<u>Connection</u>	<u>Figure</u>	<u>Fastening Description</u>
Joist to Ledger	Figure 7	<p>Where joist spacing is 12 or 16 inches on center, ledger brackets are inserted through the ledger’s prefabricated holes, and fastened to the joist with two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws.</p> <p>Where joist spacing is other than 12 or 16 inches on center, or where the ledger terminates, F-50 Brackets are utilized to fasten the joists to the ledger. Three Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws secure the bracket to the joist and three Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws attach the bracket to the ledger.</p>
Joist to Rim Joist	Figure 8	<p>Where joist spacing is 12 or 16 inches on center, two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws attach the U-Rim Joist tabs to the joists.</p> <p>Where joist spacing is other than 12 or 16 inches on center, or where the rim joist terminates, F-50 Brackets are utilized. Three Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws fasten the bracket to the joist and three Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws attach the bracket to the rim joist.</p> <p>Rim Joist Brackets are utilized to connect joists to curved rim joists. Two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws fasten the joist to the Rim Joist Brackets, and two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws fasten the Rim Joist Bracket to the curved rim joist.</p>
Joist to Beam	Figure 9	<p>When joists are flush mounted to beams, Single Hanger, Double Hanger, and 45 Degree Brackets are utilized.</p> <ul style="list-style-type: none"> ▪ Single and Double Hanger brackets are fastened to beams using six Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws, and two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws for attachment to the joists. ▪ 45 Degree Brackets fasten to beams using six Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws, and two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws for attachment to the joists. <p>When joists rest on top of the beams, F-10 and Blocking Brackets are utilized.</p> <ul style="list-style-type: none"> ▪ Where joist spacing is 12 or 16 inches on center, Joist Blocking Brackets fasten to beams using three Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws, and two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws to attach to the joists. ▪ Where joist spacing is other than 12 or 16 inches on center, F-10 Brackets fasten to beams using two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws, and two Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws to attach to the joists.
Beam to Post	Figure 11	Beams are fastened to support posts via Single and Double Beam Post brackets. Post brackets are fastened to beams with fourteen Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws, and fourteen Evolution #12-14 (0.157 in minor diameter), 3/4-inch-long self-tapping screws for attachment to the posts.
Beam Splice	Figure 12	Four 3/8-inch diameter stainless steel thru bolts are utilized for beam splices. See Figure 13 for installation details.



TABLE 2 – ALLOWABLE JOIST SPANS

Load Case	Joist Spacing	16 ga Joist		18 ga Joist	
		Maximum Supported Span/Cantilever	Maximum Reactions Ledger/Post	Maximum Supported Span/Cantilever	Maximum Reactions Ledger/Post
50 psf	12"	16'-4"/4'-8"	375 lb/675 lb	15'-4"/4'-4"	353 lb/631 lb
	16"	14'-10"/4'-3"	454 lb/818 lb	13'-11"/3'-11"	427 lb/762 lb
75 psf	12"	16'-4"/4'-8"	441 lb/793 lb	15'-4"/4'-4"	414 lb/741 lb
	16"	14'-10"/4'-3"	533 lb/962 lb	13'-11"/3'-11"	502 lb/895 lb
100 psf	12"	15'-0"/4'-3"	535 lb/957 lb	14'-1"/4'-0"	502 lb/900 lb
	16"	13'-6"/3'-10"	641 lb/1,150 lb	12'-2"/3'-5"	579 lb/1,031 lb
125 psf	12"	14'-0"/4'-0"	619 lb/1,114 lb	12'-8"/3'-7"	561 lb/1,003 lb
	16"	12'-1"/3'-5"	713 lb/1,276 lb	10'-11"/3'-1"	645 lb/1,152 lb
150 psf	12"	12'-9"/3'-7"	675 lb/1,203 lb	11'-7"/3'-3"	614 lb/1,092 lb
	16"	11'-1"/3'-2"	780 lb/1,405 lb	10'-0"/2'-10"	705 lb/1,263 lb
200 psf	12"	10'-10"/3'-1"	796 lb/1,430 lb	9'-9"/2'-9"	718 lb/1,282 lb
	16"	9'-4"/2'-8"	914 lb/1,646 lb	8'-5"/2'-5"	824 lb/1,487 lb

⁽¹⁾The maximum span length of the joists are determined for the continuous beams with both the simply-supported and cantilevered span conditions. The joist members are analyzed in accordance with AISI S100-2016. Three types of loadings conditions are considered for this analysis. The first loading condition is the uniformly distributed load at simply supported span only, second loading condition is the uniformly distributed load at both simply-supported and cantilevered span, and third loading condition is the uniformly distributed load at cantilevered span only. The maximum span length is determined by limiting the span to the maximum allowable span which meets the bending stress, shear stress, and deflection criteria for the members with the three loading conditions described above.

⁽²⁾The load cases are as follows:

Load Case	Dead Load	Live Load	Snow Load
50 psf	10 psf	40 psf	0 psf
75 psf	10 psf	40 psf	25 psf
100 psf	10 psf	40 psf	50 psf
125 psf	10 psf	40 psf	75 psf
150 psf	10 psf	40 psf	100 psf
200 psf	10 psf	40 psf	150 psf

Notes for the following Tables 3 through 14:

The maximum beam span length for single beam and double beam are determined for the joists with the simply-supported and cantilevered span conditions. The joist cantilever is limited to L/4 of the joist support. The beam members are analyzed in accordance with AISI S100-2016. The maximum span length is determined by limiting the span to the maximum allowable span which meets the bending stress, shear stress, and deflection criteria (L/360) for the members.





TABLE 3 – ALLOWABLE SINGLE BEAM SPANS (50 PSF)

50 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-1"	17'-11"	17'-0"	16'-3"	15'-6"	14'-11"	14'-4"	13'-10"	13'-5"
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-0"	17'-11"	17'-0"	16'-2"	15'-6"	14'-11"	14'-4"	13'-10"	13'-5"	13'-0"
	1'-0"	-	-	-	20'-0"	20'-0"	18'-10"	17'-10"	16'-11"	16'-2"	15'-5"	14'-10"	14'-4"	13'-10"	13'-5"	13'-0"	12'-7"
	1'-6"	-	-	-	-	-	17'-7"	16'-9"	16'-0"	15'-4"	14'-9"	14'-3"	13'-9"	13'-4"	12'-11"	12'-7"	12'-3"
	2'-0"	-	-	-	-	-	-	-	15'-2"	14'-8"	14'-2"	13'-8"	13'-3"	12'-11"	12'-6"	12'-2"	11'-11"
	2'-6"	-	-	-	-	-	-	-	-	-	13'-7"	13'-2"	12'-10"	12'-6"	12'-2"	11'-10"	11'-7"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	12'-4"	12'-1"	11'-9"	11'-6"	11'-3"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	11'-5"	11'-2"	11'-0"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=0 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 10 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 40 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 50 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building





TABLE 4 – ALLOWABLE SINGLE BEAM SPANS (75 PSF)

75 psf		Joist Span																
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"	
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	18'-9"	17'-7"	16'-7"	15'-8"	14'-11"	14'-4"	13'-9"	13'-3"	12'-9"	12'-4"	
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	18'-9"	17'-6"	16'-6"	15'-8"	14'-11"	14'-3"	13'-9"	13'-3"	12'-9"	12'-4"	12'-0"	
	1'-0"	-	-	-	19'-11"	18'-6"	17'-5"	16'-5"	15'-7"	14'-10"	14'-3"	13'-8"	13'-2"	12'-9"	12'-4"	11'-11"	11'-7"	
	1'-6"	-	-	-	-	-	16'-3"	15'-5"	14'-9"	14'-2"	13'-7"	13'-2"	12'-8"	12'-3"	11'-11"	11'-7"	11'-3"	
	2'-0"	-	-	-	-	-	-	-	14'-0"	13'-6"	13'-0"	12'-7"	12'-3"	11'-10"	11'-7"	11'-3"	10'-11"	
	2'-6"	-	-	-	-	-	-	-	-	-	12'-6"	12'-2"	11'-10"	11'-6"	11'-2"	10'-11"	10'-8"	
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	-	11'-5"	11'-1"	10'-10"	10'-7"	10'-4"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	10'-6"	10'-4"	10'-1"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	9'-10"

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=25 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 35 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 58.75 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 58.75 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building





TABLE 5 – ALLOWABLE SINGLE BEAM SPANS (100 PSF)

100 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-4"	17'-8"	16'-4"	15'-3"	14'-5"	13'-8"	13'-0"	12'-5"	11'-11"	11'-6"	11'-1"	10'-9"
	0'-6"	-	20'-0"	20'-0"	19'-3"	17'-7"	16'-3"	15'-3"	14'-4"	13'-7"	13'-0"	12'-5"	11'-11"	11'-6"	11'-1"	10'-9"	10'-5"
	1'-0"	-	-	-	17'-4"	16'-1"	15'-1"	14'-3"	13'-7"	12'-11"	12'-4"	11'-11"	11'-5"	11'-1"	10'-8"	10'-5"	10'-1"
	1'-6"	-	-	-	-	-	14'-1"	13'-5"	12'-10"	12'-4"	11'-10"	11'-5"	11'-0"	10'-8"	10'-4"	10'-1"	9'-9"
	2'-0"	-	-	-	-	-	-	-	12'-2"	11'-9"	11'-4"	10'-11"	10'-7"	10'-4"	10'-0"	9'-9"	9'-6"
	2'-6"	-	-	-	-	-	-	-	-	-	10'-10"	10'-6"	10'-3"	10'-0"	9'-8"	9'-6"	9'-3"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	9'-11"	9'-8"	9'-5"	9'-2"	9'-0"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	9'-2"	8'-11"	8'-9"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=50 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 60 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 77.5 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 77.5 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 6 – ALLOWABLE SINGLE BEAM SPANS (125 PSF)

125 psf		Joist Span																
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"	
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	19'-5"	17'-4"	15'-10"	14'-8"	13'-8"	12'-11"	12'-3"	11'-8"	11'-1"	10'-8"	10'-3"	9'-11"	9'-7"	
	0'-6"	-	20'-0"	19'-3"	17'-3"	15'-9"	14'-7"	13'-8"	12'-10"	12'-2"	11'-7"	11'-1"	10'-8"	10'-3"	9'-11"	9'-7"	9'-4"	
	1'-0"	-	-	-	15'-6"	14'-5"	13'-6"	12'-9"	12'-2"	11'-7"	11'-1"	10'-8"	10'-3"	9'-11"	9'-7"	9'-3"	9'-0"	
	1'-6"	-	-	-	-	-	12'-7"	12'-0"	11'-6"	11'-0"	10'-7"	10'-2"	9'-10"	9'-7"	9'-3"	9'-0"	8'-9"	
	2'-0"	-	-	-	-	-	-	-	10'-11"	10'-6"	10'-2"	9'-10"	9'-6"	9'-3"	8'-11"	8'-9"	8'-6"	
	2'-6"	-	-	-	-	-	-	-	-	-	9'-9"	9'-5"	9'-2"	8'-11"	8'-8"	8'-6"	8'-3"	
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	-	8'-10"	8'-7"	8'-5"	8'-3"	8'-0"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	8'-2"	8'-0"	7'-10"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	7'-7"

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=75 psf. The following Total Load Combinations were considered:

- DL + LL = 50 psf
- DL + SL/WL = 85 psf
- DL + 0.75LL + 0.75SL/WL = 96.25 psf
- L/360 = 40 psf
- L/240 = 96.25 psf

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 7 – ALLOWABLE SINGLE BEAM SPANS (150 PSF)

150 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	17'-9"	15'-10"	14'-6"	13'-4"	12'-6"	11'-9"	11'-2"	10'-7"	10'-2"	9'-9"	9'-5"	9'-1"	8'-9"
	0'-6"	-	20'-0"	17'-7"	15'-9"	14'-5"	13'-4"	12'-6"	11'-9"	11'-2"	10'-7"	10'-2"	9'-9"	9'-4"	9'-1"	8'-9"	8'-6"
	1'-0"	-	-	-	14'-2"	13'-2"	12'-4"	11'-8"	11'-1"	10'-7"	10'-1"	9'-9"	9'-4"	9'-0"	8'-9"	8'-6"	8'-3"
	1'-6"	-	-	-	-	-	11'-6"	11'-0"	10'-6"	10'-1"	9'-8"	9'-4"	9'-0"	8'-8"	8'-5"	8'-2"	8'-0"
	2'-0"	-	-	-	-	-	-	-	9'-11"	9'-7"	9'-3"	8'-11"	8'-8"	8'-5"	8'-2"	7'-11"	7'-9"
	2'-6"	-	-	-	-	-	-	-	-	-	8'-10"	8'-7"	8'-4"	8'-1"	7'-11"	7'-9"	7'-6"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	8'-1"	7'-10"	7'-8"	7'-6"	7'-4"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	7'-5"	7'-3"	7'-1"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=100 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 110 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 115 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 115 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 8 – ALLOWABLE SINGLE BEAM SPANS (200 PSF)

200 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	17'-5"	15'-0"	13'-5"	12'-3"	11'-4"	10'-7"	9'-11"	9'-5"	8'-11"	8'-7"	8'-3"	7'-11"	7'-7"	7'-4"
	0'-6"	-	17'-0"	14'-10"	13'-4"	12'-2"	11'-3"	10'-6"	9'-11"	9'-5"	8'-11"	8'-7"	8'-2"	7'-11"	7'-7"	7'-4"	7'-2"
	1'-0"	-	-	-	12'-0"	11'-2"	10'-5"	9'-10"	9'-4"	8'-11"	8'-6"	8'-2"	7'-11"	7'-7"	7'-4"	7'-2"	6'-11"
	1'-6"	-	-	-	-	-	9'-9"	9'-3"	8'-10"	8'-6"	8'-2"	7'-10"	7'-7"	7'-4"	7'-1"	6'-11"	6'-8"
	2'-0"	-	-	-	-	-	-	-	8'-5"	8'-1"	7'-9"	7'-6"	7'-3"	7'-1"	6'-10"	6'-8"	6'-6"
	2'-6"	-	-	-	-	-	-	-	-	-	7'-6"	7'-3"	7'-0"	6'-10"	6'-8"	6'-6"	6'-4"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	6'-9"	6'-7"	6'-5"	6'-3"	6'-2"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	6'-3"	6'-1"	6'-0"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=150 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 160 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 152.5 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 160 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 9 – ALLOWABLE DOUBLE BEAM SPANS (50 PSF)

50 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	1'-0"	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	1'-6"	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	2'-0"	-	-	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	2'-6"	-	-	-	-	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-8"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	20'-0"	20'-0"	20'-0"	19'-7"	19'-2"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	19'-6"	19'-1"	18'-8"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=0 psf. The following Total Load Combinations were considered:

- DL + LL = 50 psf
- DL + SL/WL = 10 psf
- DL + 0.75LL + 0.75SL/WL = 40 psf
- L/360 = 40 psf
- L/240 = 50 psf

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 10 – ALLOWABLE DOUBLE BEAM SPANS (75 PSF)

75 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"
	1'-0"	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-9"
	1'-6"	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-9"	19'-2"
	2'-0"	-	-	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-8"	19'-2"	18'-8"
	2'-6"	-	-	-	-	-	-	-	-	-	20'-0"	20'-0"	20'-0"	19'-7"	19'-1"	18'-7"	18'-2"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	19'-5"	18'-11"	18'-6"	18'-1"	17'-8"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	17'-11"	17'-7"	17'-3"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=25 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 35 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 58.75 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 58.75 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 11 – ALLOWABLE DOUBLE BEAM SPANS (100 PSF)

100 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-7"	18'-11"	18'-3"
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-6"	18'-10"	18'-3"	17'-9"
	1'-0"	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-6"	18'-10"	18'-3"	17'-8"	17'-2"
	1'-6"	-	-	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-5"	18'-9"	18'-2"	17'-8"	17'-2"	16'-8"
	2'-0"	-	-	-	-	-	-	-	20'-0"	20'-0"	19'-3"	18'-8"	18'-1"	17'-7"	17'-1"	16'-8"	16'-3"
	2'-6"	-	-	-	-	-	-	-	-	-	18'-6"	17'-11"	17'-5"	17'-0"	16'-7"	16'-2"	15'-9"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	16'-10"	16'-5"	16'-1"	15'-8"	15'-4"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	15'-7"	15'-3"	14'-11"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

⁽¹⁾ All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

⁽²⁾ Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=50 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 60 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 77.5 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 77.5 \text{ psf}$$

⁽³⁾ Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

⁽⁴⁾ Joist and beam capacities are determined in accordance with AISI S100-16.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building



TABLE 12 – ALLOWABLE DOUBLE BEAM SPANS (125 PSF)

125 psf		Joist Span															
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-10"	18'-11"	18'-2"	17'-6"	16'-11"	16'-5"
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-9"	18'-11"	18'-2"	17'-6"	16'-11"	16'-4"	15'-11"
	1'-0"	-	-	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-8"	18'-10"	18'-2"	17'-6"	16'-11"	16'-4"	15'-10"	15'-5"
	1'-6"	-	-	-	-	-	20'-0"	20'-0"	19'-7"	18'-9"	18'-0"	17'-5"	16'-10"	16'-3"	15'-10"	15'-4"	14'-11"
	2'-0"	-	-	-	-	-	-	-	18'-7"	17'-11"	17'-3"	16'-9"	16'-3"	15'-9"	15'-4"	14'-11"	14'-6"
	2'-6"	-	-	-	-	-	-	-	-	-	16'-7"	16'-1"	15'-8"	15'-3"	14'-10"	14'-6"	14'-2"
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	15'-1"	14'-9"	14'-5"	14'-1"	13'-9"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	14'-0"	13'-8"	13'-5"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=75 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 85 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 96.25 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 96.25 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building

PCA-101



TABLE 13 – ALLOWABLE DOUBLE BEAM SPANS (150 PSF)

150 psf		Joist Span																
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"	
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-0"	18'-1"	17'-4"	16'-8"	16'-0"	15'-6"	15'-0"	
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-0"	18'-1"	17'-4"	16'-7"	16'-0"	15'-5"	14'-11"	14'-6"	
	1'-0"	-	-	-	20'-0"	20'-0"	20'-0"	19'-10"	18'-10"	18'-0"	17'-3"	16'-7"	16'-0"	15'-5"	14'-11"	14'-6"	14'-1"	
	1'-6"	-	-	-	-	-	19'-7"	18'-8"	17'-10"	17'-2"	16'-6"	15'-11"	15'-4"	14'-11"	14'-5"	14'-0"	13'-8"	
	2'-0"	-	-	-	-	-	-	-	17'-0"	16'-4"	15'-9"	15'-3"	14'-10"	14'-5"	14'-0"	13'-7"	13'-3"	
	2'-6"	-	-	-	-	-	-	-	-	-	15'-2"	14'-8"	14'-3"	13'-11"	13'-7"	13'-3"	12'-11"	
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	-	13'-10"	13'-6"	13'-2"	12'-10"	12'-7"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	12'-9"	12'-6"	12'-3"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	11'-11"

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=100 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 110 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 115 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 115 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building





TABLE 14 – ALLOWABLE DOUBLE BEAM SPANS (200 PSF)

200 psf		Joist Span																
		1'-0"	2'-0"	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	10'-0"	11'-0"	12'-0"	13'-0"	14'-0"	15'-0"	16'-0"	
Joist Cantilever	0'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	20'-0"	19'-3"	18'-0"	16'-11"	16'-1"	15'-4"	14'-8"	14'-1"	13'-6"	13'-1"	12'-8"	
	0'-6"	-	20'-0"	20'-0"	20'-0"	20'-0"	19'-2"	17'-11"	16'-11"	16'-1"	15'-3"	14'-8"	14'-1"	13'-6"	13'-1"	12'-8"	12'-3"	
	1'-0"	-	-	-	20'-0"	19'-0"	17'-10"	16'-10"	16'-0"	15'-3"	14'-7"	14'-0"	13'-6"	13'-0"	12'-7"	12'-3"	11'-11"	
	1'-6"	-	-	-	-	-	16'-7"	15'-10"	15'-1"	14'-6"	13'-11"	13'-5"	13'-0"	12'-7"	12'-2"	11'-10"	11'-6"	
	2'-0"	-	-	-	-	-	-	-	14'-4"	13'-10"	13'-4"	12'-11"	12'-6"	12'-2"	11'-10"	11'-6"	11'-2"	
	2'-6"	-	-	-	-	-	-	-	-	-	12'-10"	12'-5"	12'-1"	11'-9"	11'-5"	11'-2"	10'-11"	
	3'-0"	-	-	-	-	-	-	-	-	-	-	-	-	11'-8"	11'-4"	11'-1"	10'-10"	10'-7"
	3'-6"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	10'-9"	10'-6"	10'-4"
	4'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	10'-1"

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=150 psf. The following Total Load Combinations were considered:

$$DL + LL = 50 \text{ psf}$$

$$DL + SL/WL = 160 \text{ psf}$$

$$DL + 0.75LL + 0.75SL/WL = 152.5 \text{ psf}$$

$$L/360 = 40 \text{ psf}$$

$$L/240 = 160 \text{ psf}$$

(3) Deflection limits for joists and beams are based on L/360 for live load and L/240 for total load.

(4) Joist and beam capacities are determined in accordance with AISI S100-16.





TABLE 15 – ALLOWABLE POST HEIGHTS

Dead Load	Live Load	Snow Load	Maximum Deck Tributary Area	Maximum Post Height
10 psf	40 psf	0 psf	200 ft ²	120.0 in.
10 psf	40 psf	50 psf	200 ft ²	120.0 in.
10 psf	40 psf	75 psf	200 ft ²	120.0 in.
10 psf	40 psf	100 psf	150 ft ²	120.0 in.
			200 ft ²	109.3 in.
10 psf	40 psf	150 psf	100 ft ²	120.0 in.
			150 ft ²	101.5 in.

(1) All loads and load combinations are determined using ASCE 7-16. LL=Live Load, DL=Dead Load, SL=Snow Load

(2) Loads used to produce this table are as follows: LL=40 psf, DL=10 psf, SL=150 psf. The following Total Load Combinations were considered:

- DL + LL = 50 psf
- DL + SL/WL = 160 psf
- DL + 0.75LL + 0.75SL/WL = 152.5 psf
- L/360 = 40 psf
- L/240 = 160 psf





PARTS SHOWN

- 1. S-Ledger (pre-spaced 12" & 16" O.C.)
- 2. Ledger Bracket
- 3. Joist (2"x6")
- 4. F50 Bracket
- 5. Strap (mid-span blocking)
- 6. Beam (2"x11")
- 7. Beam Cap
- 8. Post to Beam Bracket
- 9. Post (3½"x3½"x10')
- 10. Blocking (12" & 16" O.C.)
- 11. Post to Pier Bracket
- 12. Single Hanger Brackets
- 13. Rim Joist (pre-spaced 12" & 16" O.C.)

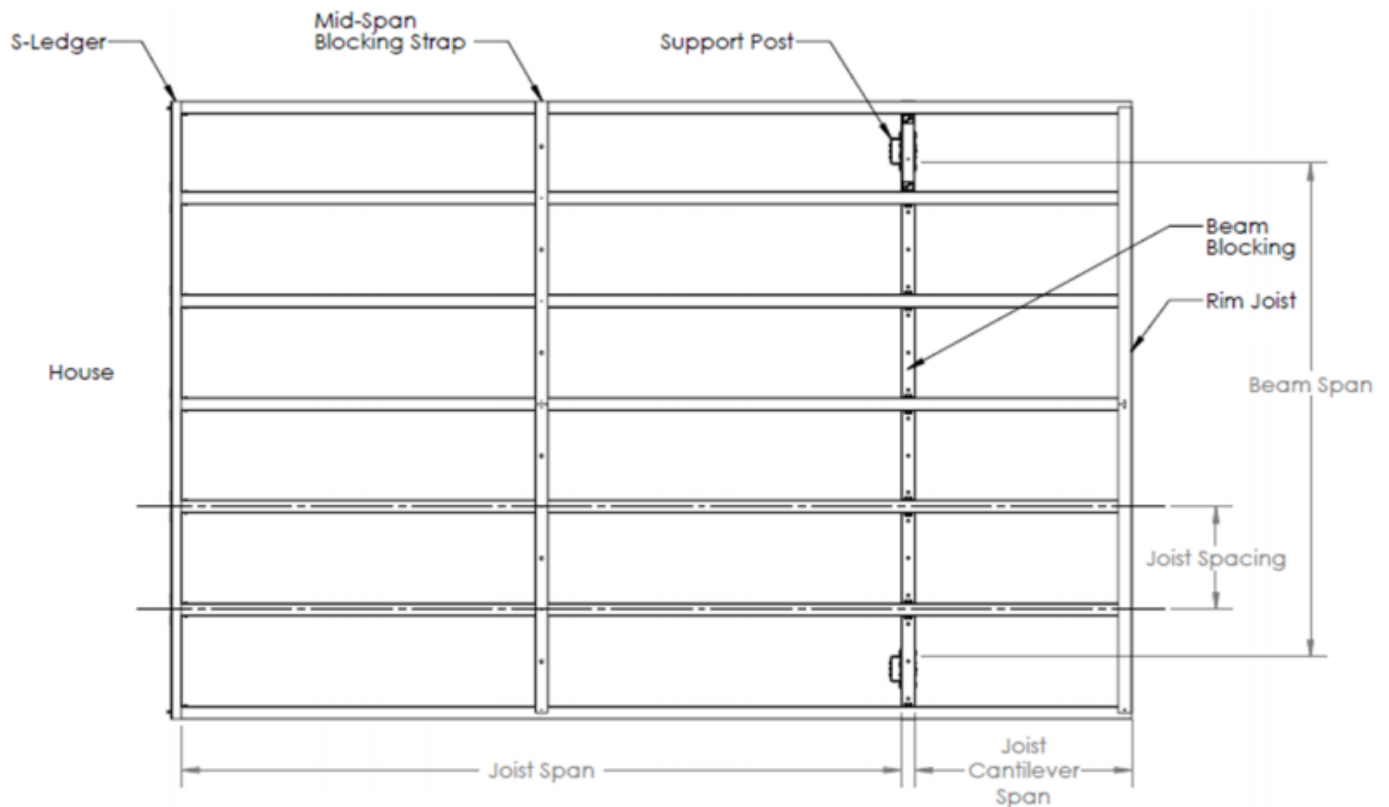
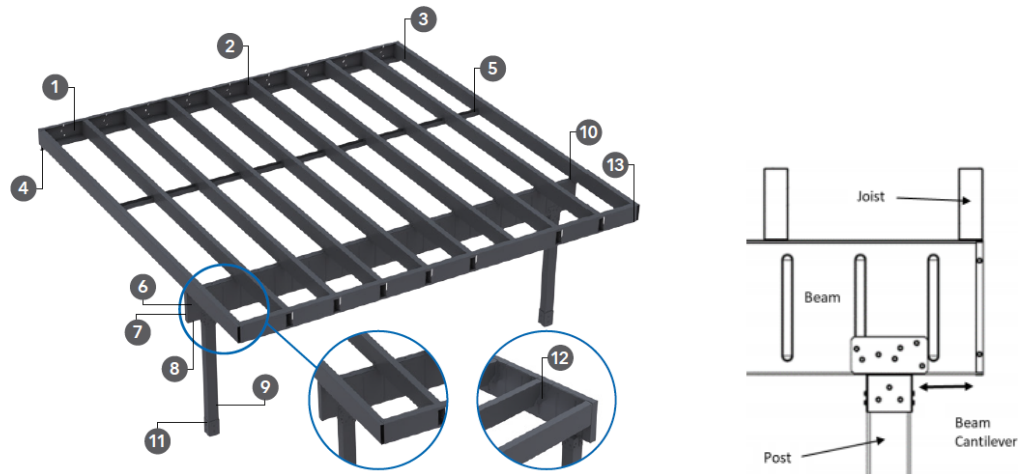


FIGURE 1 – EVOLUTION DECK FRAMING ASSEMBLY



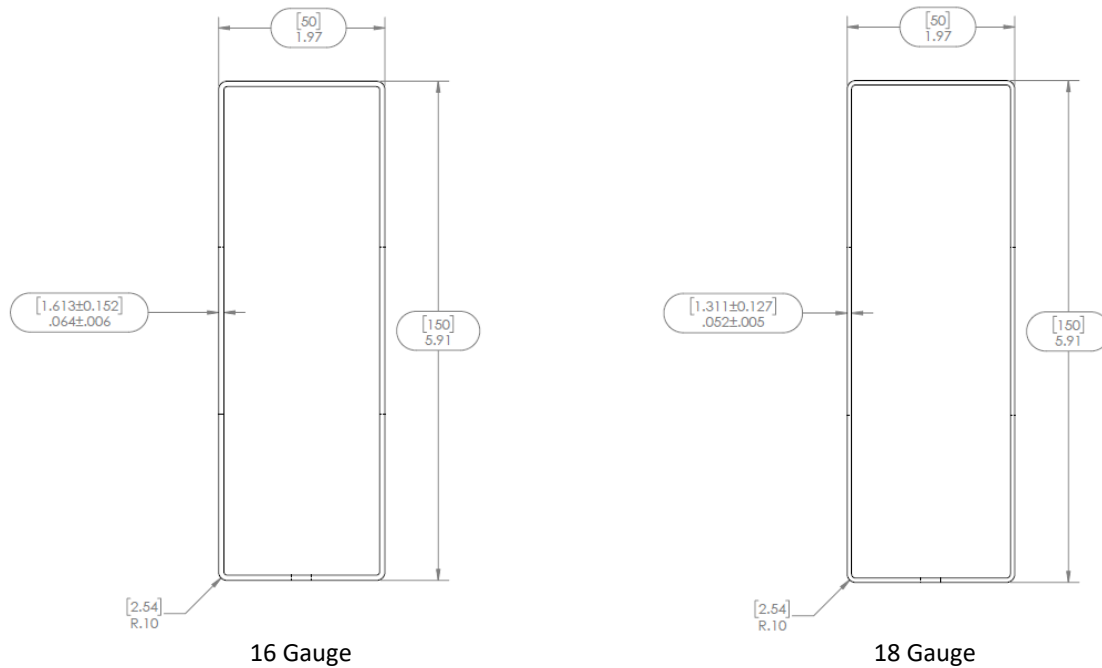


FIGURE 2 – STEEL JOISTS

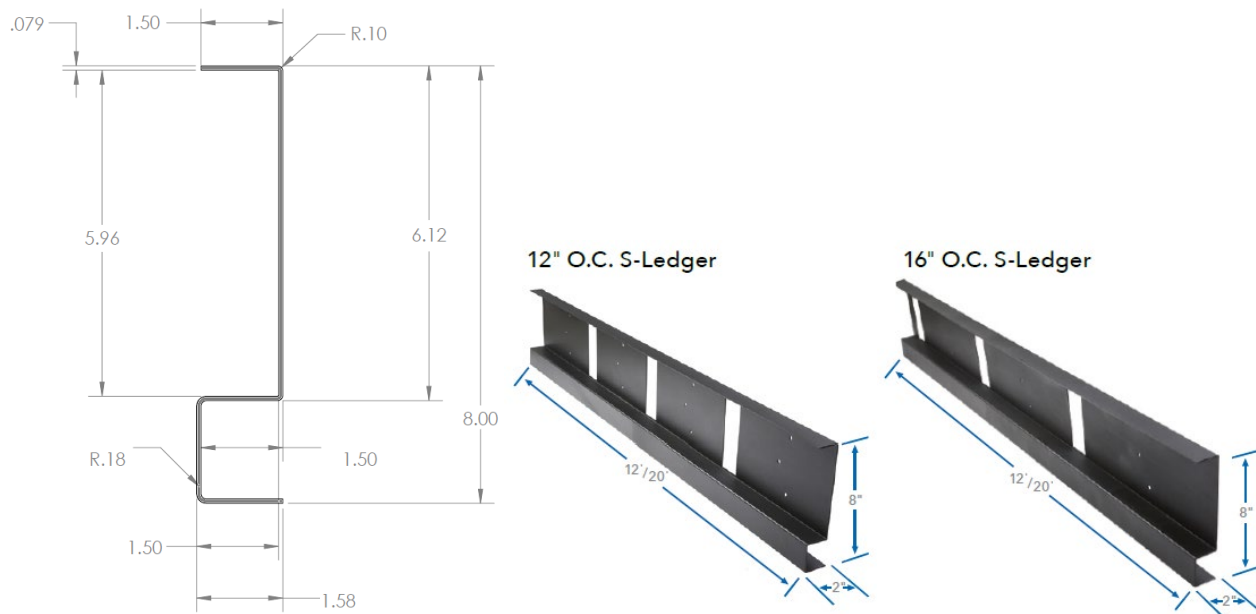


FIGURE 3 – LEDGERS



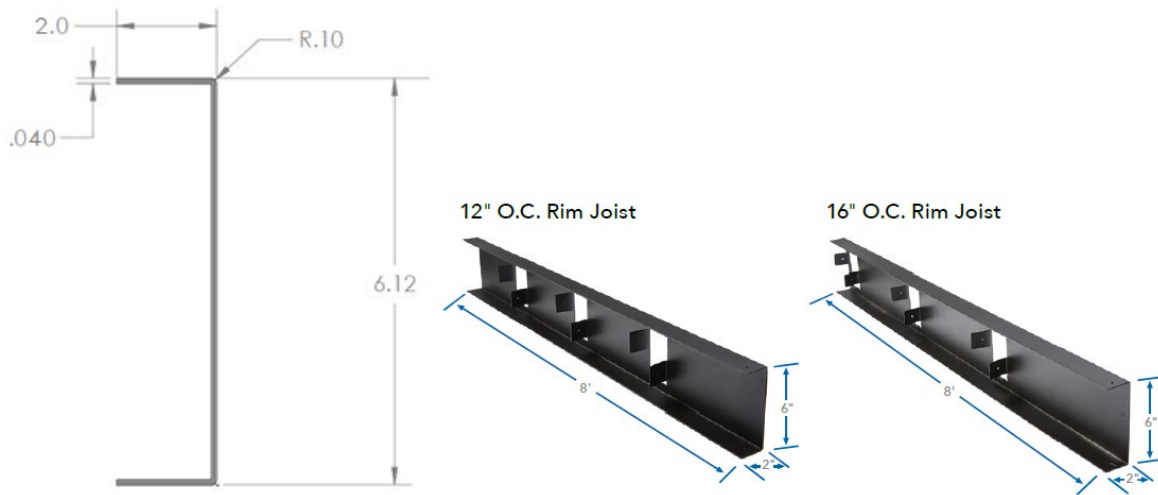


FIGURE 4 – RIM JOISTS



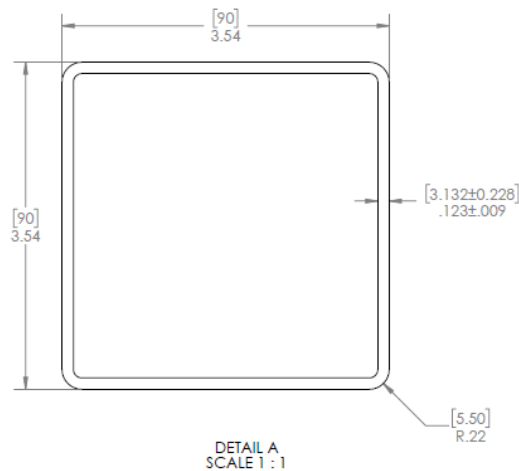



FIGURE 5 – SUPPORT POSTS

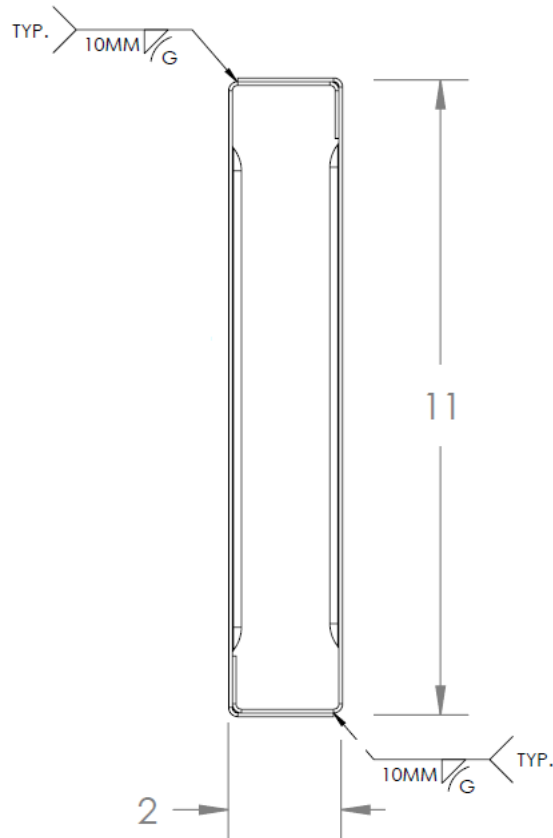

WELDS SPACED EVERY 24" APART
TOP AND BOTTOM
WELDS ARE STAGGERED TOP TO BOTTOM EVERY 12"

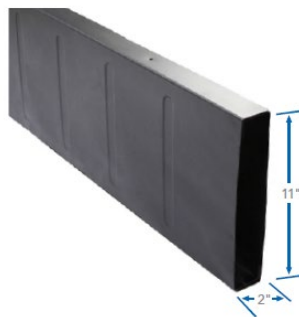

Single Beam





Double Beam (with Track)



Double Beam Track

FIGURE 6 – BEAMS

On both ends of the S-Ledger, and anywhere there's non-standard spacing, the F-50 Bracket is used to attach the joist in place of the Ledger Bracket. Attached using Evolution self-drilling screws.

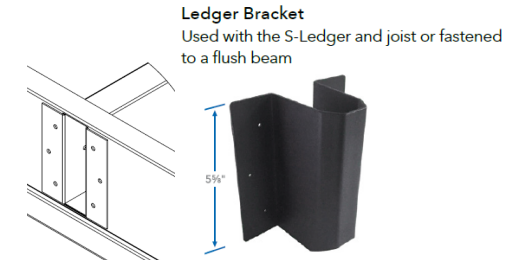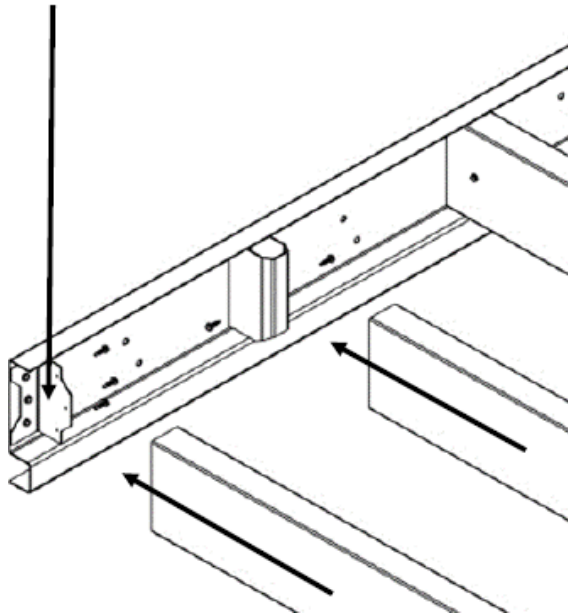


Ledger Bracket used for 12" or 16" joist spacing

F-50 Bracket
Used with S-Ledger, joist, and blocking as well as many other applications



Ledger Bracket used for non-standard joist spacing

FIGURE 7 – JOIST TO LEDGER CONNECTION

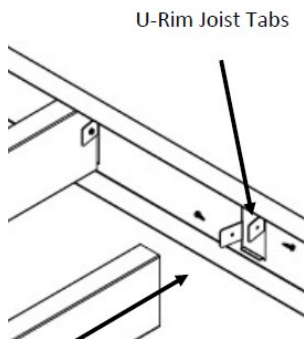

F-50 Bracket
Used with S-Ledger, joist, and blocking as well as many other applications



F-50 Bracket used for non-standard joist spacing

Rim Joist Bracket
Inserts into joist at the end of the deck for attaching the Curved Rim Joist








FIGURE 8 – JOIST TO RIM JOIST CONNECTION

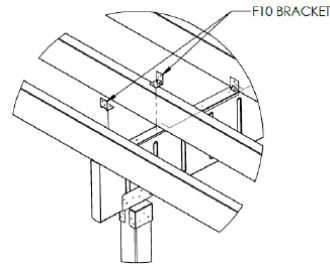


Blocking
Manufactured to match the same spacing as the S-Ledger for easy blocking of joist on a dropped beam

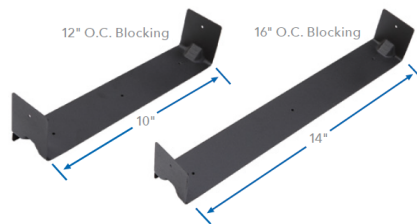



F-10 Bracket
Used to secure joist to a drop beam when non-standard spacing is required and as a cap on the bottom of the S-Ledger

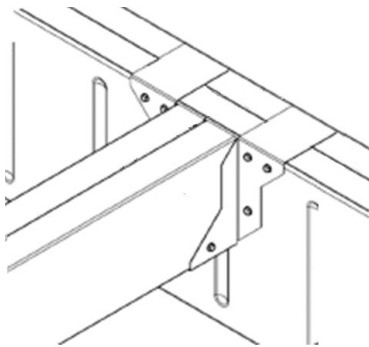

Double Hanger Bracket
Used to secure double joist or create a double (2"x6") carry beam

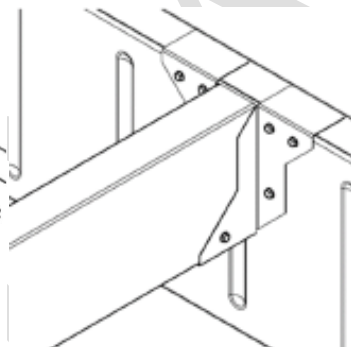

Single Hanger Bracket
Used to secure joist to flush beam applications



45° Bracket
Used with the Blank S-Ledger when joist extends at an angle to keep standard spacing




FIGURE 9 – JOIST TO BEAM CONNECTION






Strap

Manufactured to match the same spacing as the S-Ledger for easy mid-span blocking applications

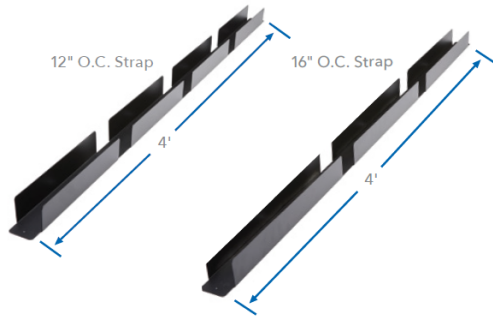

Joist Blocking


for non-standard joist spacing

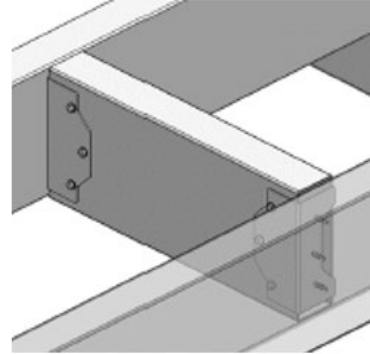

For Joist Spans greater than 8', blocking is required midspan at every bay.

There are two different installation options for the 12" O.C. and 16" O.C. straps; one for ground level decks and one for elevated decks.

Ground Level Decks

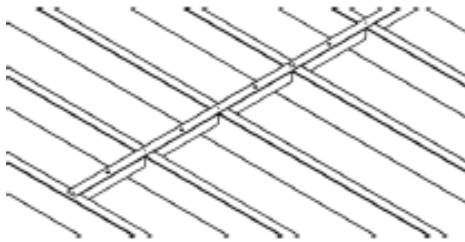


Using Evolution 12" or 16" O.C. Straps, Place on the **TOPSIDE** of the joist. The strap is 4' long and will cover (4) Joist for the 12" O.C. version and (3) Joist on the 16" O.C. version.

This method should only be used when the deck is ground-level and not accessible from the bottom side.

No fasteners are required when installing Strap on the top-side

Elevated Decks

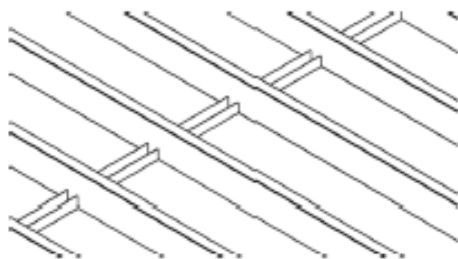


Using Evolution 12" or 16" O.C. Straps, place on the **UNDERSIDE** of the joist. The strap is 4' long and will cover (4) Joist for the 12" O.C. version and (3) Joist on the 16" O.C. version.

This is the preferred method for installation and should be used anytime there's access to the bottom of the deck.

FIGURE 10 – JOIST BLOCKING




Single Beam to Post

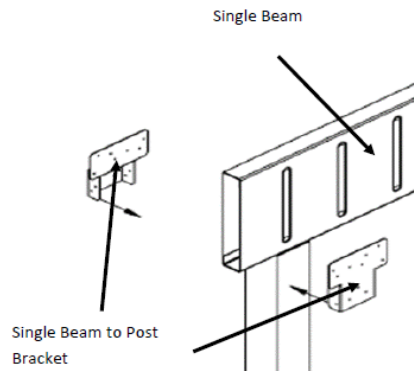

Single Beam/Post Bracket
Used to secure post to single beam




Double Beam to Post

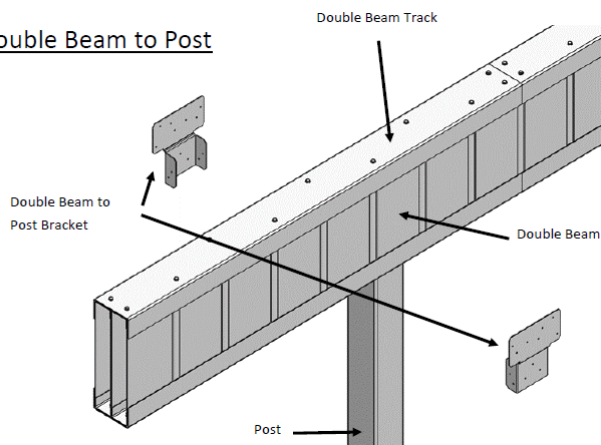

Double Beam/Post Bracket
Used to secure post to double beam



FIGURE 11 – BEAM TO POST CONNECTIONS

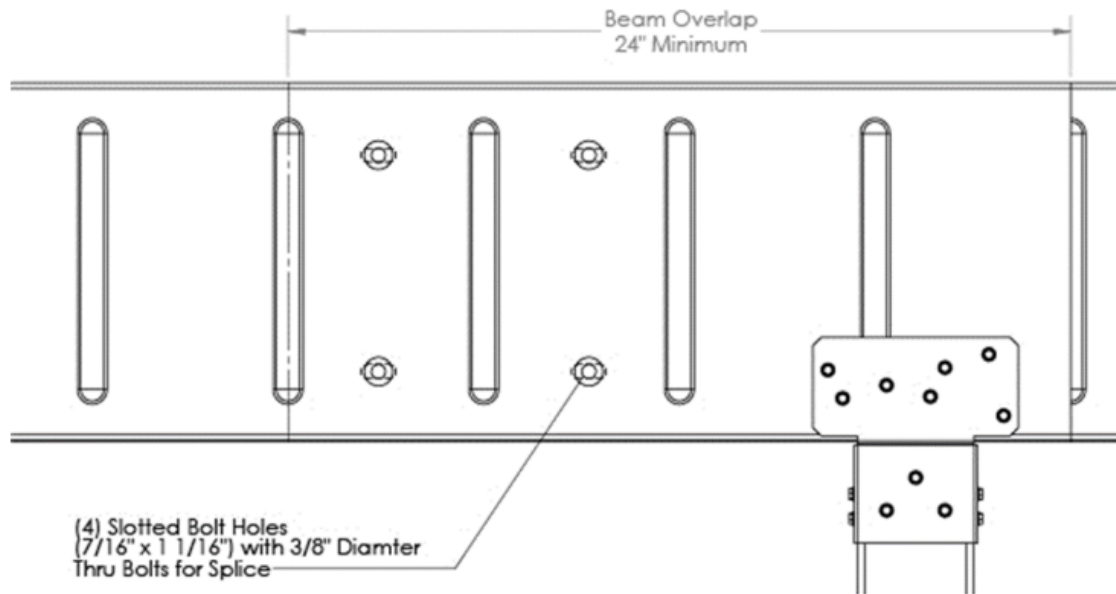

When splicing two beams, there must be 24" of overlap between the two beams. The splice must be supported by a post at any location within the beam overlap.

The beam splice is connected with (4) slotted bolt holes 7/16" x 1 1/16" with 3/8" diameter thru bolts.

FIGURE 12 – BEAM SPLICING